



NOTES


- [1]
REMOTE DEVICE
- [2]
EXTERNAL TO ENCLOSURE.
- [3]
SEE INSTRUCTION SHEET 41063-241-01 FOR ADDING MODULES AND ALL OTHER WIRES NOT CONNECTED.
- [4]
900-TC'S NEED TO START AT NODE 32.
SET ALL TC'S CMW TO ON.
SET ALL TC'S BAUD RATES TO:
8
1
NONE
- [5]
TEMPERATURE CONTROLLER PROGRAMMED FOR USE WITH J TYPE THERMOCOUPLE.
- [6]
SAFETY RELAY SHOWN WITH MONITORED AUTOMATIC RESET CIRCUIT.
- [7]
WHEN USING THE SAFE OFF FUNCTION AT THE PF40P DRIVE. REMOVE THE HARDWARE ENABLE JUMPER AND THE SAFE-OFF CONNECTION JUMPER FROM THE DRIVE. REFER TO PFLEX-UM003 PUBLICATION FOR DETAILS.

GENERAL NOTES
"C" DENOTES CLEAN WIREWAY CONNECTION
"D" DENOTES DIRTY WIREWAY CONNECTION






FACE VIEW
LEFT SIDE OF
ENCLOSURE

CONNECTION DIAGRAM



TOP OF ENCLOSURE

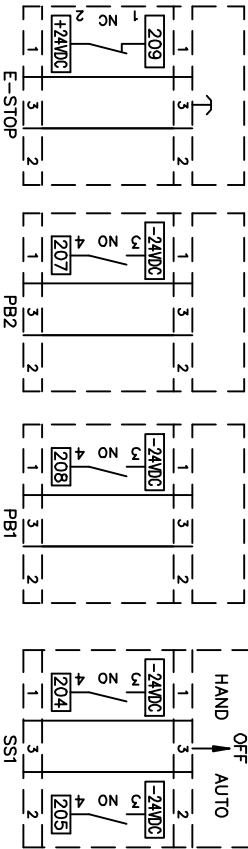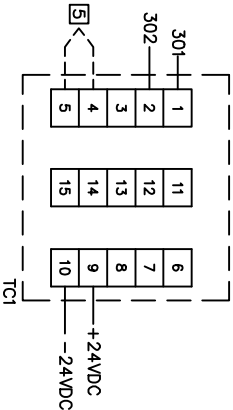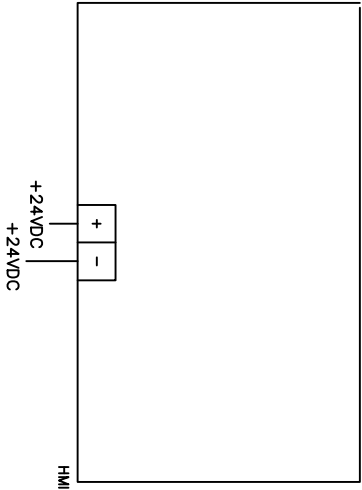

DOOR
(REAR VIEW)

References		BULLETIN 1000-S	
Revision		CCBB DEMO	
Release			
1			
Dr. D.WINDUS		Date 4-14-08	Sheet 7 of 8
Chkd.		Date	Dwg Size
Appd.		Date	D
Refer. Book			